



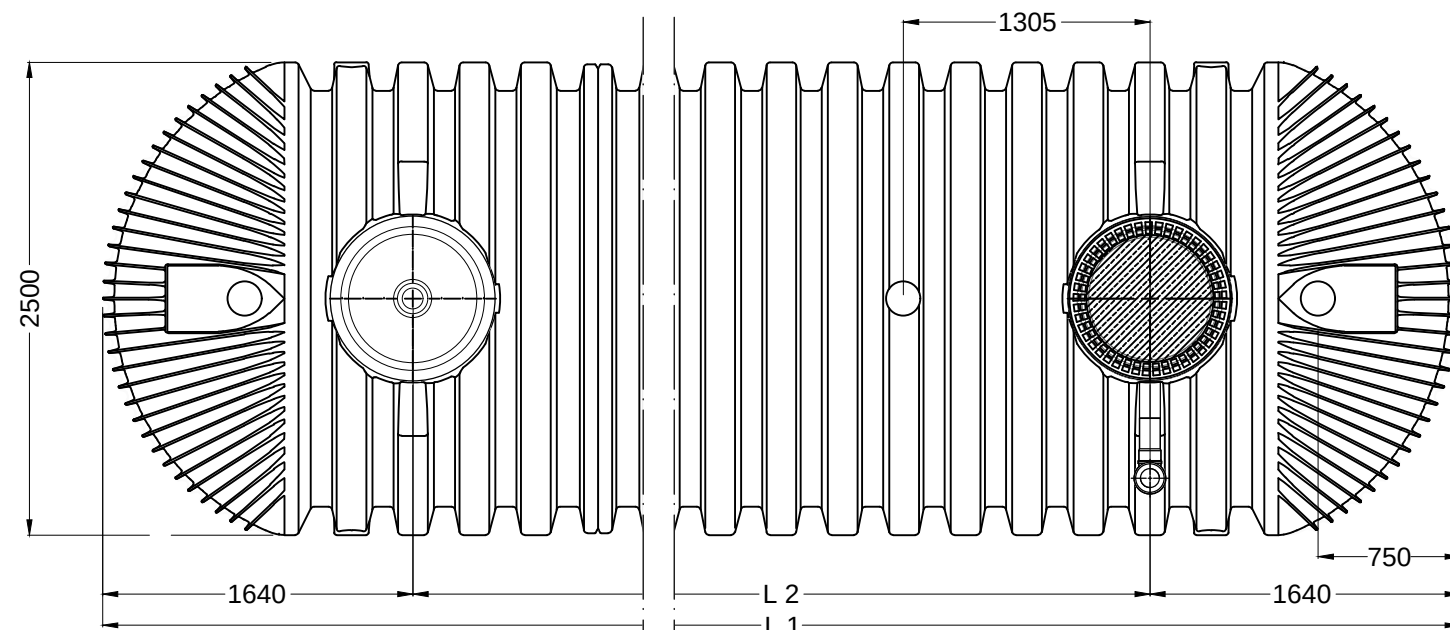


driveability with lorry SLW 40
with earth covering 1000 -1500 mm

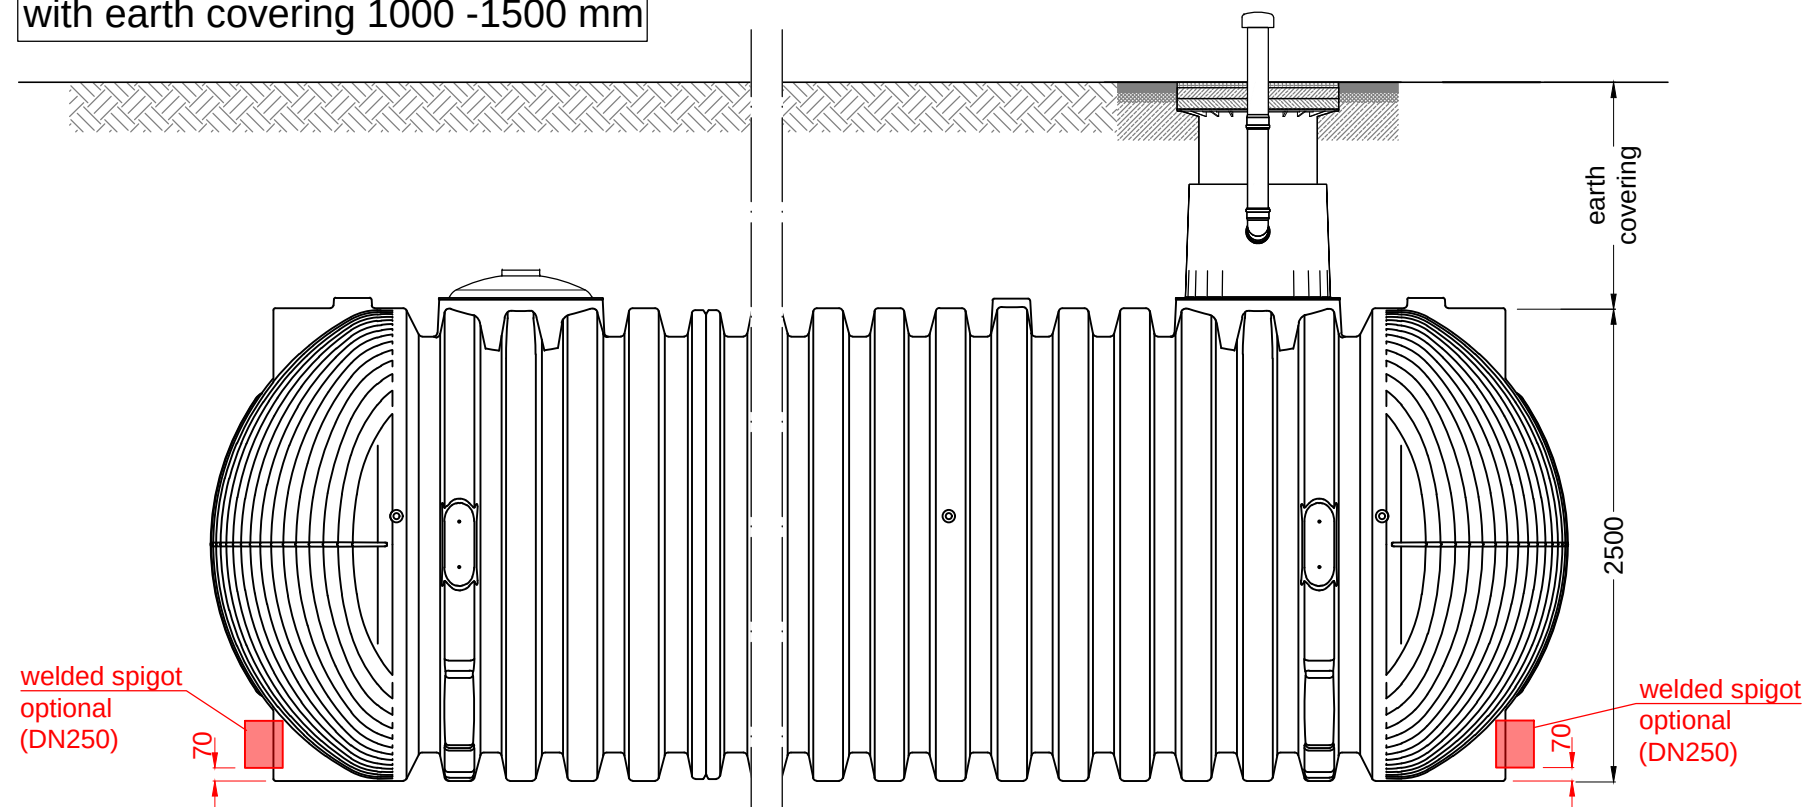

welded spigot
optional
(DN250)

welded spigot
optional
(DN250)

firefighting watertank Carat XXL						
Art.-No.	total volume (Liter)	usable volume (Liter)	length L1 (mm)	length L2 (mm)	weight (kg)	
380151	22.000	19.800	6230	2930	1046	
380152	26.000	23.400	7200	3900	1146	
380153	32.000	28.800	8440	5140	1421	
380154	36.000	32.400	9410	6110	1516	
380155	42.000	37.800	10680	7380	1811	
380156	46.000	41.400	11650	8350	1906	
380157	52.000	46.800	12920	9620	2196	
380158	56.000	50.400	13890	10590	2296	
380159	62.000	55.800	15160	11860	2586	
380160	66.000	59.400	16130	12830	2681	
380161	72.000	64.800	17400	14100	2976	
380162	76.000	68.400	18370	15070	3071	
380163	82.000	73.800	19640	16340	3361	
380164	86.000	77.400	20610	17310	3456	
380165	92.000	82.800	21880	18580	3751	
380166	96.000	86.400	22850	19550	3846	
380167	102.000	91.800	24120	20820	4136	
380168	106.000	95.400	25090	21790	4231	
380169	112.000	100.800	26360	23060	4526	
380170	116.000	104.400	27330	24030	4621	
380171	122.000	109.800	28600	25300	4916	

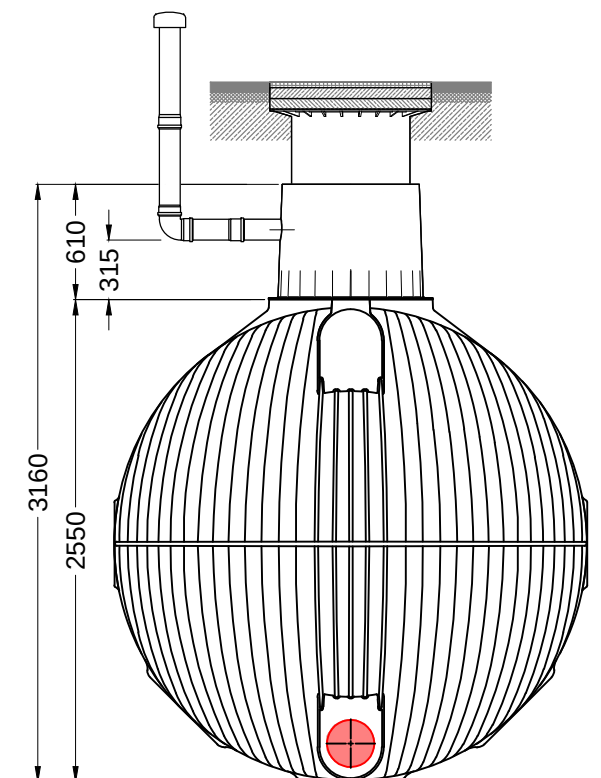

The installation conditions must be checked before installation!

The respective installation regulations must be observed in accordance with our installation instructions.
No liability can be accepted for unknown geographical conditions and pipelines.



Emergency overflows and vents may be undersized. Please also check the height of the drawn emergency overflows for any risk of backflow into the inlet pipe.

With your signature you confirm the acknowledgement.

PRODUCTION RELEASE

Name:	Date:
Stamp / Signature:	

revision			
revision			
GRAF Carat XXL - firefighting watertank total volume 22000 L / 5812 gal - 122000 L / 32229 gal			Artikel-Nr. product no. article no. articulo no. 380151-380171
Project:			page 1 of 2
gezeichnet drawn	VHI	Gewicht weight	see table
Datum date	2025.05.26	Toleranz tolerance	+/- 3%
Maßstab scale	M 1:40	Einheiten units	mm [inch] gal. = US gal.
Otto Graf GmbH Carl-Zeiss-Str. 2-6 DE-79331 Teninger mail@graf.info www.graf.info			
 			

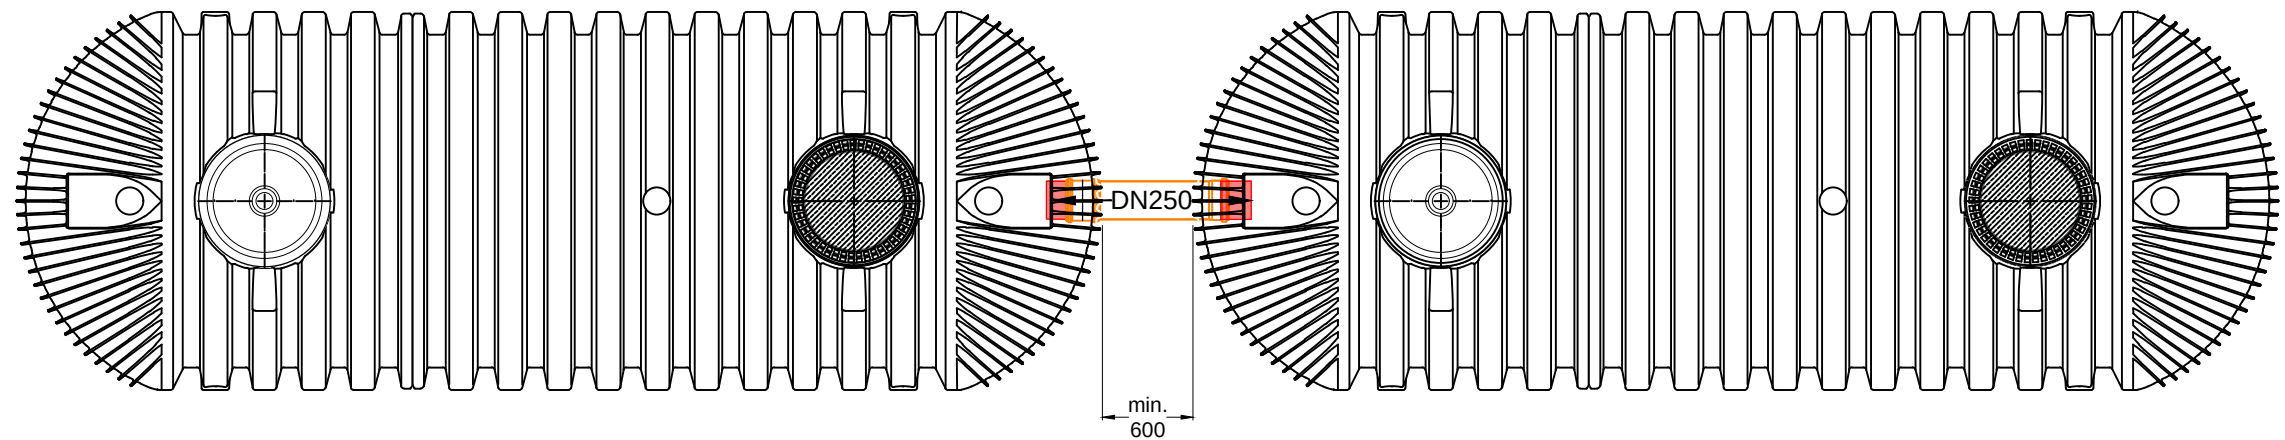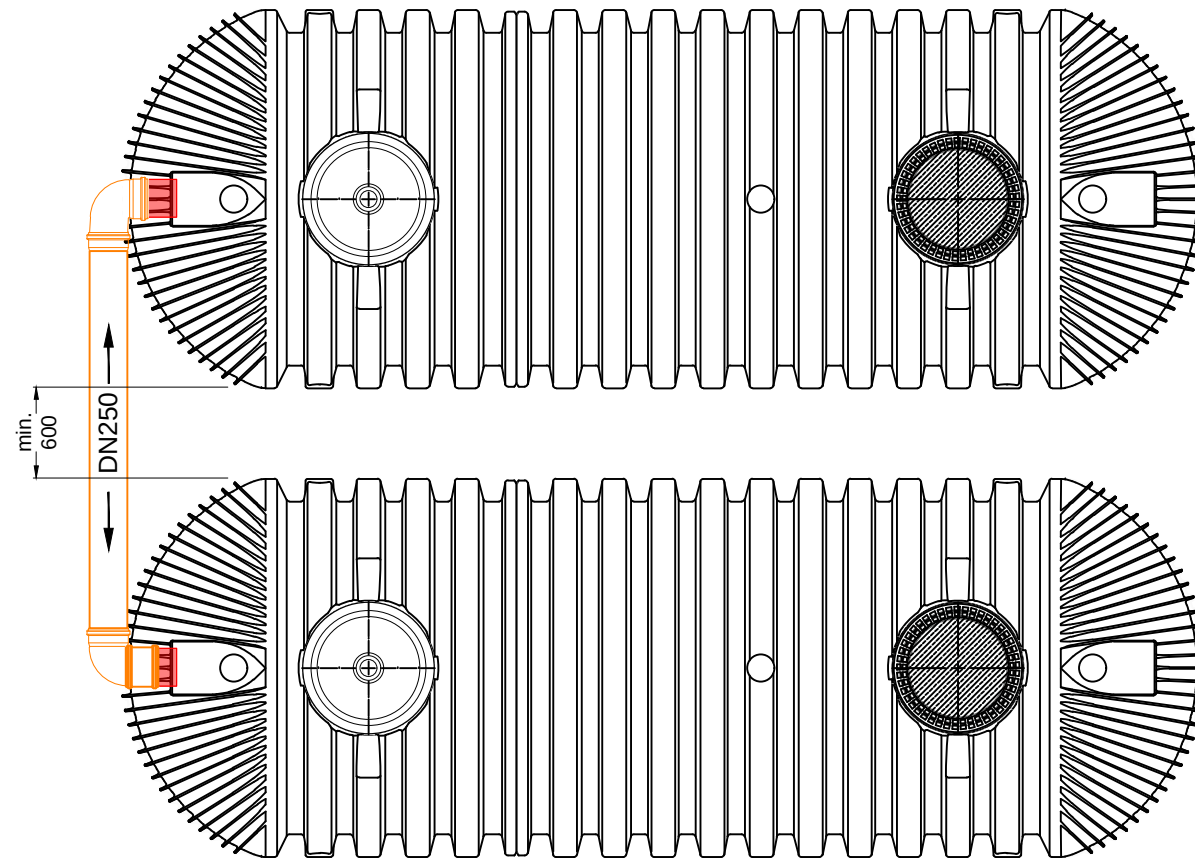

The installation conditions must be checked before installation!

The respective installation regulations must be observed in accordance with our installation instructions.
No liability can be accepted for unknown geographical conditions and pipelines.

Emergency overflows and vents may be undersized. Please also check the height of the drawn emergency overflows for any risk of backflow into the inlet pipe.

With your signature you confirm the acknowledgement.

PRODUCTION RELEASE

Name:	Date:
Stamp / Signature:	

revision				
revision				
GRAF Carat XXL - firefighting watertank layout of tanks			Artikel-Nr. product no. article no. articulo no.	
Project:			<u>page 2 of 2</u>	
gezeichnet drawn	VHI	Gewicht weight	Otto Graf GmbH Carl-Zeiss-Str. 2-6 DE-79331 Teningen mail@graf.info www.graf.info  	
Datum date	2025.05.26	Toleranz tolerance		+/- 3%
Maßstab scale	M 1:50	Einheiten units		mm [inch] gal. = US gal.